




FIRE HYDRANT ASSEMBLY

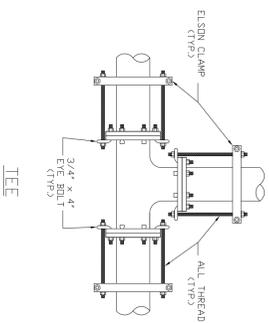

FITTING ANCHORS

- NOTES:
1. WEGA-LUGS MAY BE USED IN PLACE OF ELSON CLAMPS AND ALL THREAD TO RESTRAIN JOINTS.
  2. ALL NUTS, WASHERS AND ALL THREAD SHALL BE STAINLESS STEEL.

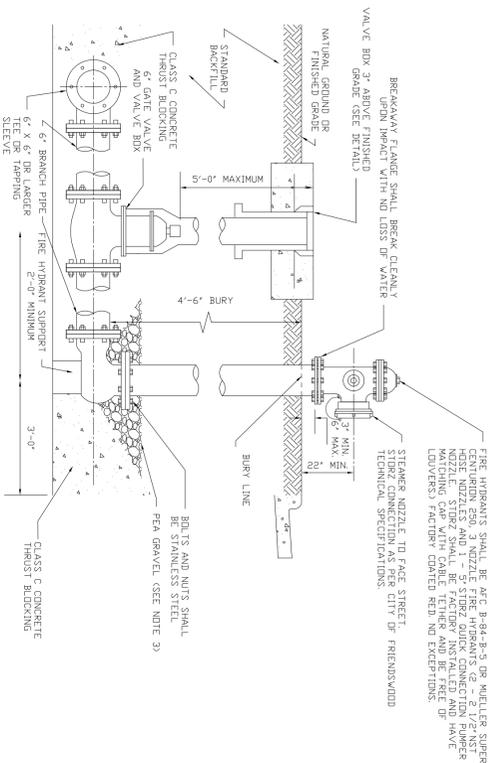

FIRE HYDRANT ASSEMBLY

1. RESTRAINED JOINTS SHALL BE USED. SEE FITTING ANCHOR DETAIL.
2. FRICTION JOINTS SHALL BE SLOTTED AND PAINTED ACCORDING TO THE CITY OF PEABODY SPECIFICATIONS.
3. FILL PEA GRAVEL TO A MINIMUM DEPTH OF 6\"/>



WATERLINE MARKER

WATER DISTRIBUTION  
STANDARD DETAILS  
(CONTINUED)

FILE NAME: 16-WDS02-2022.DWG  
DATE APPROVED: FEBRUARY 27, 2026  
SCALE: NTS  
REVISED DATE: FEBRUARY 2026



ENGINEERING  
DEPARTMENT

PROJECT NUMBER: DATE SUBMITTED: SHEET: 2 OF 2